



HUTTER FREI POWER GMBH



References

Combined Cycle Gas Turbine CHP Stations SYSTEM HUTTER

and

Thermal Combined Heat and Power Stations



References of delivered SYSTEM HUTTER and further CHP Stations

- **Combined Cycle CHP Station SYSTEM HUTTER Varel 1**
for Paper- and Board Mill VAREL; Varel, Germany
- **Combined Cycle CHP Station Repowering to SYSTEM HUTTER Buchmann 1**
for Board Mill BUCHMANN; Annweiler-Sarnstall, Germany
- **Combined Cycle CHP Station SYSTEM HUTTER Smurfit Kappa BKPO 1**
for Board Mill SMURFIT KAPPA BADISCHE KARTON & PAPPEN; Obertsrot, Germany
- **Combined Cycle CHP Station SYSTEM HUTTER Smurfit Kappa Europa Carton Hoya 1**
for Paper Mill SMURFIT KAPPA EUROPA CARTON; Hoya, Germany
- **Combined Cycle CHP Station SYSTEM HUTTER Varel 2**
for Paper- and Board Mill VAREL; Varel, Germany
- **Combined Cycle CHP Station SYSTEM HUTTER Varel 3**
for Paper- and Board Mill VAREL; Varel, Germany
- **Combined Cycle CHP Station SYSTEM HUTTER Buchmann 2**
for Board Mill BUCHMANN; Annweiler-Sarnstall, Germany
- **Extension of Heating Plant with Steam Turbine Plant - Refurbishment and Modernisation of a used Steam Turbine**
Paper Mill STORA ENSO UETERSEN, Uetersen, Germany
- **Waste Incineration Plant Mainz Line 3 – Overall Concept, Integration, Engineering and Delivery of Energy part around Steam Turbine**
KRAFTWERKE MAINZ-WIESBADEN – Entsorgungsgesellschaft Mainz mbH, Mainz, Germany
- **Combined Cycle CHP Station SYSTEM HUTTER UPM Nordland Papier 1** (Design, Pre-Engineering, Authority Permitting)
UPM NORDLAND PAPIER; Dörpen, Germany



Operation Experience of Combined Cycle CHP Stations SYSTEM HUTTER

7 CHP Stations SYSTEM HUTTER in Operation

Cumulative Operating Experience:

- 155 Years
- 1'370'000 Operating Hours

Longest Operating Experience:


- 31 Years
- 270'000 Operating Hours

Time-Reliability:

- > 99.5 % for entire Power Station
- \varnothing 99.98 % for Steam Generator Plant

Plant Reference sizes per block:

- from 7.2 MW_{el.} / 32 t/h live steam
- to 25.6 MW_{el.} / 95 t/h live steam

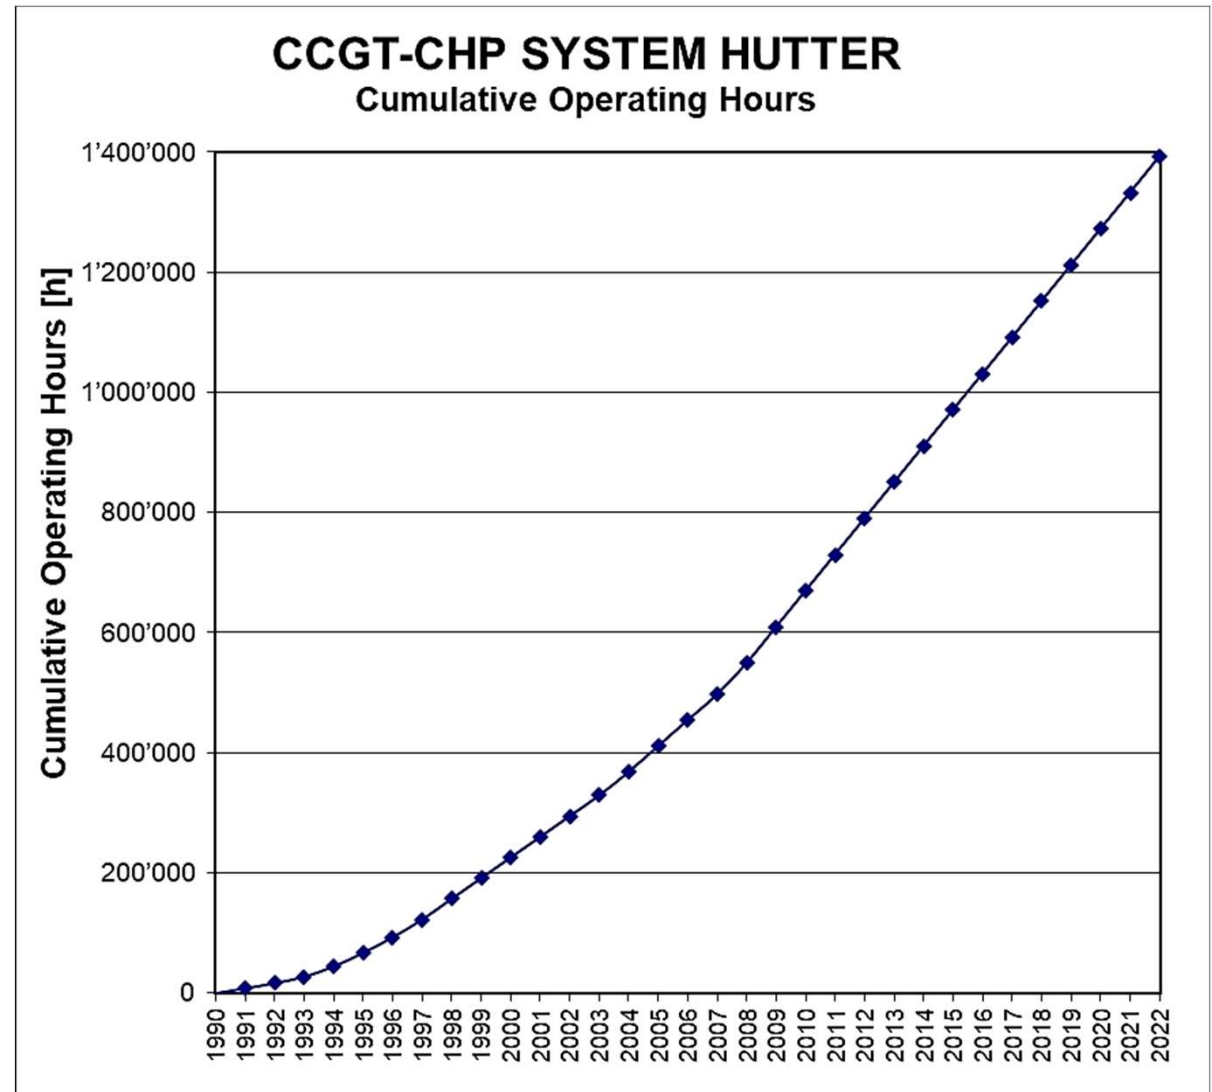



Combined Cycle CHP Station SYSTEM HUTTER Varel 1


Type:	Combined Cycle CHP Station SYSTEM HUTTER CH 45		
Project Scope:	New Combined Gas Turbine & Steam Turbine CHP Station with existing Steam Turbo Set		
Customer:	PAPER- AND CARDBOARD Mill VAREL; Varel, Germany		
Commissioning & Hand-over	1989		
Yearly Operation Hours	8600	h	
Gas Turbine Model	Solar Centaur H		
Nominal Electr. Power Gas Turbo Set ISO	4.4	MW	
Steam Turbine Type	Back-pressure		
Nominal Electr. Power Steam Turbo Set	5.6	MW	
Nominal Total Electrical Capacity	10.0	MW	
Nominal Live Steam Massflow	45	t/h	
Nominal Live Steam Condition	64	bar	
	450	°C	
Process Steam Pressure	3.6	bar	
Fuel	Natural gas / Bio gas		
Install. Firing Rate Boiler at combined cycle	2 x 19	MW	
Fuel Utilisation Factor	93	%	
Time-Reliability	> 99	%	
Emissions (ref. to 3 Vol-% O ₂ dry)			
NO _x	75	ppm	
CO	< 5	ppm	
CO ₂ (ref. to useful Electr.- & Heating Energy)	229.2	kg/MWh	





Combined Cycle CHP Station SYSTEM HUTTER Buchmann 1

Type:	Combined Cycle CHP Station SYSTEM HUTTER Repowering CH 65		
Project Scope:	Retrofit existing heavy oil-fired HP-Steam Generator & Installation of Gas Turbine upstream Steam Generator		
Customer:	CARDBOARD MILL BUCHMANN; Annweiler-Sarnstall, Germany		
Commissioning & Hand-over	1992		
Yearly Operation Hours	8600	h	
Gas Turbine Model	Solar Taurus T60		
Nominal Electr. Power Gas Turbo Set ISO	4.6	MW	
Steam Turbine Type	Extraction-Condensing		
Nominal Electr. Power Steam Turbo Set	10.5	MW	
Nominal Total Electrical Capacity	15.1	MW	
Nominal Live Steam Massflow	65	t/h	
Nominal Live Steam Condition	110	bar	
	520	°C	
Process Steam Pressure	9.0/3.6	bar	
Fuel	Natural gas		
Install. Firing Rate Boiler at Combined Cycle	3 x 17	MW	
Fuel Utilisation Factor	93	%	
Time-Reliability	> 99	%	
Emissions (ref. to 3 Vol-% O ₂ dry)			
NO _x	70	ppm	
CO	< 5	ppm	
CO ₂ (ref. to useful Electr.- & Heating Energy)	230.4	kg/MWh	

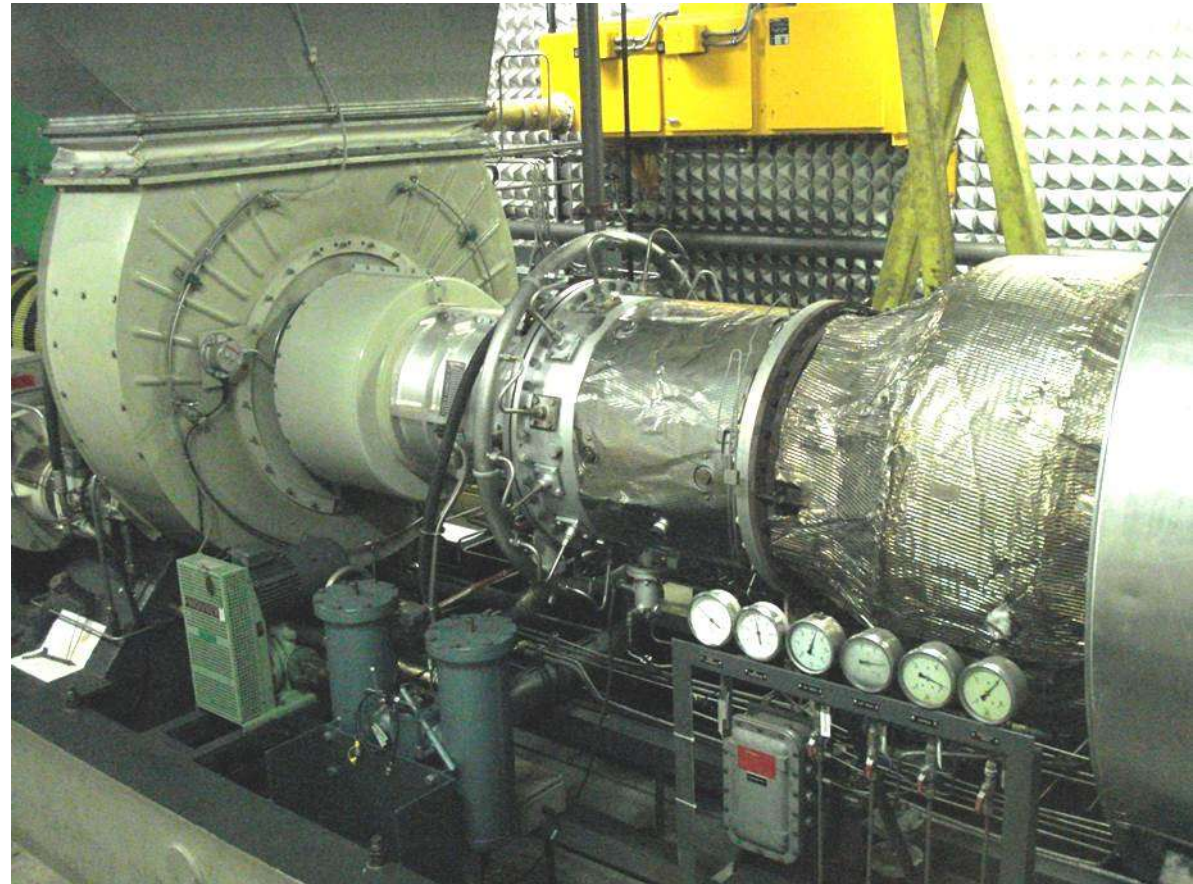



Combined Cycle CHP Station SYSTEM HUTTER Smurfit Kappa BKPO 1

Type:	Combined Cycle CHP Station SYSTEM HUTTER CH 50		
Project Scope:	New Combined Gas Turbine & Steam Turbine CHP Station with existing Steam Turbo Set		
Customer:	Cardboard Mill SMURFIT KAPPA BADISCHE KARTON; Obertsrot, Germany		
Commissioning & Hand-over	1994		
Yearly Operation Hours	8600	h	
Gas Turbine Model	Solar Taurus T60		
Nominal Electr. Power Gas Turbo Set ISO	4.6	MW	
Steam Turbine Type	Extraction-Condensing		
Nominal Electr. Power Steam Turbo Set	10.0	MW	
Nominal Total Electrical Capacity	14.6	MW	
Nominal Live Steam Massflow	50	t/h	
Nominal Live Steam Condition	64	bar	
	480	°C	
Process Steam Pressure	3.8	bar	
Fuel	Natural gas & Fuel Oil No. 2		
Install. Firing Rate Boiler at Combined Cycle	2 x 17	MW	
Fuel Utilisation Factor	92.5	%	
Time-Reliability	> 99	%	
Emissions (ref. to 3 Vol-% O ₂ dry)			
NO _x	60	ppm	
CO	< 5	ppm	
CO ₂ (ref. to useful Electr.- & Heating Energy)	229.2	kg/MWh	





Combined Cycle CHP Station SYSTEM HUTTER Smurfit Kappa HOYA 1

Type:	Combined Cycle CHP Station SYSTEM HUTTER CH 45		
Project Scope:	Complete new Combined Gas Turbine & Steam Turbine CHP Station		
Customer:	Paper Mill SMURFIT KAPPA HOYA; Hoya, Germany		
Commissioning & Hand-over	1996		
Yearly Operation Hours	8600	h	
Gas Turbine Model	Rolls Royce KB7		
Nominal Electr. Power Gas Turbo Set ISO	5.1	MW	
Steam Turbine Type	Back-pressure		
Nominal Electr. Power Steam Turbo Set	4.5	MW	
Nominal Total Electrical Capacity	9.6	MW	
Nominal Live Steam Massflow	45	t/h	
Nominal Live Steam Condition	64	bar	
	450	°C	
Process Steam Pressure	4.3	bar	
Fuel	Natural gas		
Install. Firing Rate Boiler at Combined Cycle	2 x 16	MW	
Fuel Utilisation Factor	92	%	
Time-Reliability	> 99	%	
Emissions (ref. to 3 Vol-% O ₂ dry)			
NO _x	50	ppm	
CO	< 5	ppm	
CO ₂ (ref. to useful Electr.- & Heating Energy)	231.7	kg/MWh	





Combined Cycle CHP Station SYSTEM HUTTER Varel 2

Type:	SYSTEM HUTTER CH 65		
Project Scope:	Complete new Combined Gas Turbine & Steam Turbine CHP Station		
Customer:	PAPER- AND CARDBOARD MILL VAREL; Varel, Germany		
Commissioning & Hand-over	2002		
Yearly Operation Hours	8600	h	
Gas Turbine Model	Siemens SGT-300		
Nominal Electr. Power Gas Turbo Set ISO	7.9	MW	
Steam Turbine Type	Back-pressure		
Nominal Electr. Power Steam Turbo Set	8.5	MW	
Nominal Total Electrical Capacity	16.4	MW	
Nominal Live Steam Massflow	65	t/h	
Nominal Live Steam Condition	70	bar	
	480	°C	
Process Steam Pressure	6.0	bar	
Fuel	Natural gas		
Install. Firing Rate Boiler at Combined Cycle	2 x 28	MW	
Fuel Utilisation Factor	92.5	%	
Time-Reliability	> 99	%	
Emissions (ref. to 3 Vol-% O ₂ dry)			
NO _x	35	ppm	
CO	< 5	ppm	
CO ₂ (ref. to useful Electr.- & Heating Energy)	229.2	kg/MWh	





Combined Cycle CHP Station SYSTEM HUTTER Buchmann 2

Type:	Combined Cycle CHP Station SYSTEM HUTTER CH 30		
Project Scope:	New Combined Gas Turbine & Steam Turbine CHP Station with existing Steam Turbo Set		
Customer:	CARDBOARD MILL BUCHMANN; Annweiler-Sarnstall, Germany		
Commissioning & Hand-over	2007		
Yearly Operation Hours	8600	h	
Gas Turbine Model	Rolls Royce KB5		
Nominal Electr. Power Gas Turbo Set ISO	3.5	MW	
Steam Turbine Type	Extraction-Back-pressure		
Nominal Electr. Power Steam Turbo Set	3.7	MW	
Nominal Total Electrical Capacity	7.2	MW	
Nominal Live Steam Massflow	26	t/h	
Nominal Live Steam Condition	45	bar	
	450	°C	
Process Steam Pressure	9.0/3.6 bar		
Fuel	Natural gas		
Install. Firing Rate Boiler at Combined Cycle	1 x 15	MW	
Fuel Utilisation Factor	90.2	%	
Time-Reliability	> 99	%	
Emissions (ref. to 3 Vol-% O ₂ dry)			
NO _x	45	ppm	
CO	< 40	ppm	
CO ₂ (ref. to useful Electr.- & Heating Energy)	237.9	kg/MWh	





Steam Turbine CHP Station, Stora Enso Uetersen 1

Type:	Repowering to Steam Turbine CHP Station with existing Steam Generators		
Project Scope:	Search & Evaluation of used Steam Turbines; Refurbishment & Modernisation of used Steam Turbine, Modernisation of Hydraulics, New Electrical, New Control, Instrumentation & Piping & Valves Project Mgmt, Engineering, Arrangement Plan., Erection Mgmt, Commission.		
Customer:	Paper Mill STORA ENSO UETERSEN, Uetersen, Germany		
Commissioning & Hand-over	2007		
Yearly Operation Hours	8600	h	
Nominal Electr. Power Steam Turbo Set	7	MW	
Nominal Live Steam Massflow	57	t/h	
Nominal Live Steam Condition	42	bar	
	460	°C	
Process Steam Pressure	3.9	bar	
Installed Firing Rate Boiler	2 x 22.5 MW (Fuel Gas)		
Fuel Utilisation Factor	91	%	
Time-Reliability	> 99	%	





Combined Cycle CHP Station SYSTEM HUTTER Varel 3

Type:	Combined Cycle CHP Station SYSTEM HUTTER CH 95 G		
Project Scope:	New Combined Gas Turbine & Steam Turbine CHP Station with existing Steam Turbo Set		
Customer:	PAPER- AND CARDBOARD MILL VAREL; Varel, Germany		
Commissioning & Hand-over	2008		
Yearly Operation Hours	8600	h	
Gas Turbine Model	Solar Taurus T65		
Nominal Electr. Power Gas Turbo Set ISO	2 x 6.3	MW	
Steam Turbine Type	Back-pressure		
Nominal Electr. Power Steam Turbo Set	13	MW	
Nominal Total Electrical Capacity	25.6	MW	
Nominal Live Steam Massflow	95	t/h	
Nominal Live Steam Condition	65 - 90	bar	
	460 - 480	°C	
Process Steam Pressure	6.0	bar	
Fuel	Natural gas		
Install. Firing Rate Boiler at Combined Cycle	2 x 28	MW	
Fuel Utilisation Factor	92	%	
Time-Reliability	> 99	%	
Emissions (ref. to 3 Vol-% O ₂ dry)			
NO _x	30	ppm	
CO	< 5	ppm	
CO ₂ (ref. to useful Electr.- & Heating Energy)	231.7	kg/MWh	





Waste Incineration CHP Plant Mainz Line 3

Type: Waste Incineration CHP Plant


Project Scope for Energy Part: Overall concept, Engineering, Integration, Arrangement Plan., Erection, Commissioning; Turn-key Delivery of Energy Part around Steam Turbo Set

For Waste Incineration Line 3: Quality Control of the entire mechanical erection, Overall Commissioning Mgmt

For Integration of all Plants at Site: System-Engineering for the energetic integration of the waste incineration, the gas turbine- & steam turbine power plant, the existing energy part, the new energy part with steam turbo set, the district heating extraction, and tie-in of the new steam consumption supply system.

Customer: ENTORGUNGS-GESELLSCHAFT MAINZ, Mainz, Germany

Commissioning & Hand-over	2009	
Yearly Operation Hours	8200	h
Nominal Electr. Power Steam Turbo Set	20.7	MW
Extraction-Condensing-Turbine		
Nominal Live Steam Massflow to ST	90	t/h
Nominal Live Steam Condition	40	bar
	415	°C
Extraction Steam Pressure 1	3.4	bar
Extraction Steam Pressure 2	0.7 – 1.9	bar
Condensate Preheating	5.1	MW
Exhaust Steam directly cooled in condenser with river water		
Exhaust Steam Pressure	0.05	bar
Max. Cooling Water Massflow	5200	m ³ /h
Planned with 2-stage District Heating	25	MW
Time-Reliability	> 99	%

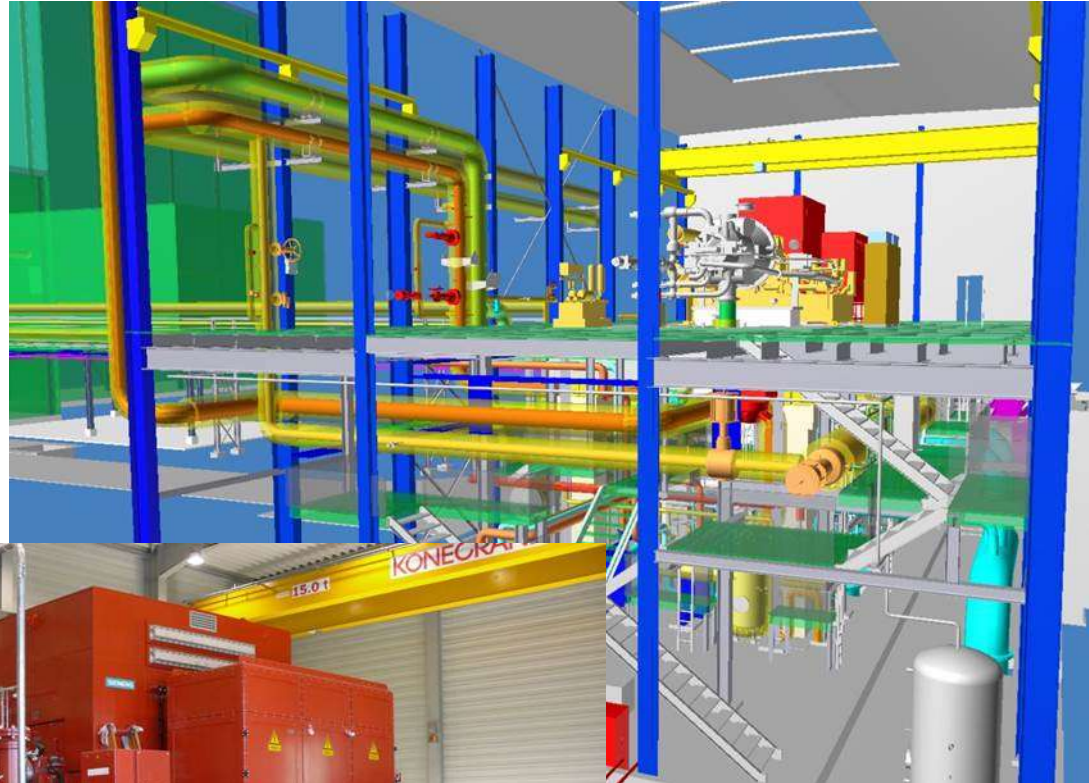



Combined Cycle CHP Station SYSTEM HUTTER UPM Nordland Papier 1

Type:	Combined Cycle CHP Station SYSTEM HUTTER 2 x CH 200		
Project Scope:	Design, Permitting & Pre-Engineering for complete new Combined Gas Turbine & Steam Turbine CHP Station		
Customer:	Paper Mill UPM Nordland Papier GmbH, Dörpen, Germany		
Authority Permit received:	July 2011		
Planned Yearly Operation Hours	8600	h	
Nominal Electr. Power Gas Turbo Set ISO	2 x 42	MW	
Steam Turbine Type	Back-pressure		
Nominal Electr. Power Steam Turbo Set	70	MW	
Nominal Total Electrical Capacity	154	MW	
Nominal Live Steam Massflow	2 x 200	t/h	
Nominal Live Steam Condition	92	bar	
	505	°C	
Process Steam Pressure	6	bar	
Fuel	Natural Gas		
Installed Firing Rate at Combined Cycle	4 x 30	MW per Boiler	
Fuel Utilisation Factor	> 90	%	
CO ₂ (ref. to useful Electr.- & Heating Energy)	238	kg/MWh	





HUTTER FREI POWER GMBH

Contact

Hutter Frei Power GmbH

Sonnhaldenweg 11
CH-5610 Wohlen (Schweiz / Switzerland)

Tel./Phone: +41 56 470 90 50
Telefax: +41 56 470 90 51
E-mail: office@hutter-frei.com
Homepage: www.hutter-frei.com

Patrick Frei, M.Sc.

Sonnhaldenweg 11
CH-5610 Wohlen (Schweiz / Switzerland)

Tel./Phone: +41 (0)56 470 90 53
Telefax: +41 (0)56 470 90 51
E-mail: patrick.frei@hutter-frei.ch



HUTTER FREI POWER GMBH

Disclaimer

HUTTER FREI POWER GMBH Copyright © 2021

Preliminary / for discussion purposes only. All Rights reserved.